


See UM Consultant Procedures and Design Guidelines. All design guidelines posted are applicable. Information below supplements and supersedes information provided in Division 10 of those documents.

## 10 1424 Signage

1. Room signage and wayfinding signage shall be coordinated by CF PM/MUHC PDC. Signage is provided by MU Health Care unless otherwise directed. In the event that signage is to be included in the design documents, use the following standards:
  - Room signs are installed at 60” to the top of the sign and 4” from the door frame on the door handle side.
  - Location may vary due to wall space allowance.
  - Signs could be mounted opposite of the door handle side, or on an adjacent wall.
  - No other application should be installed within 16.5” from the door frame and within 62” from the floor on the side designated for room signage.
  - The area past 14.5” from door frame and below 48” can be reviewed for other applications. Approval for this shall come from CF PM/MUHC PDC.

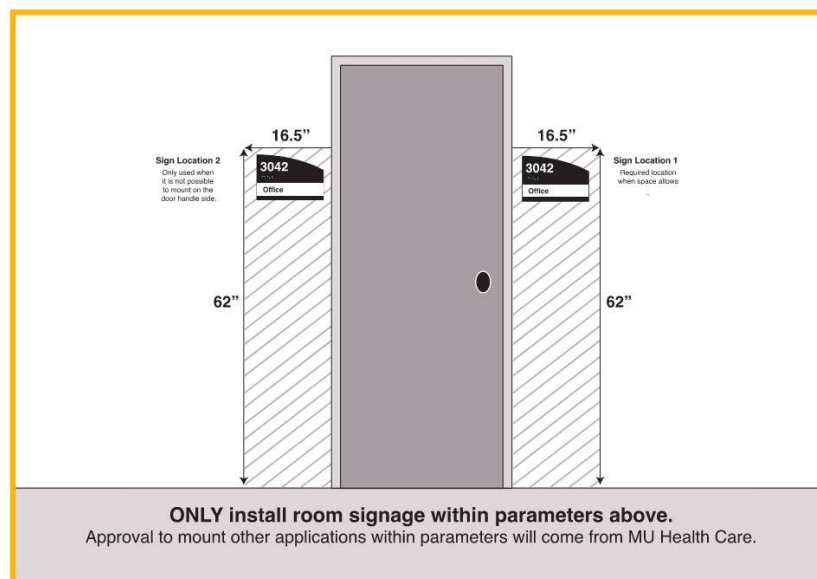

2. Coordinate room numbering with CF PM/MUHC PDC.
  - Room numbering shall follow MUHC/MU Alpha/numeric room numbering guidelines.
  - Numbering strategy shall be established at the Design Development phase and be carried throughout the project.
  - Example (P0000)
    - Prefix to be the building code designation.
    - First number to indicate the floor level.
    - Next three numbers for specific room on floor up to 999.
  - Consultant must prepare room numbering recommendations in accordance with UM Consultant Procedures and Design Guidelines and submit through the CF PM/MUHC PDC for approval by end of Design Development and again before the final review. Room number changes are not allowed without approval from CF PM/MUHC PDC.
3. Include required signage and decals to meet fire department requirements, i.e., roof access points, hydrants, numbered exterior doors visible with light reflective material that is 4” wide minimum.

### **10 2113 Plastic Toilet Compartments**

1. Basis of Design: Bobrick DuraLine Series
  - Compact Laminate Solid Core Construction
  - Laminate Clad
  - Floor-Mounted, Overhead Braced.

- Minimum 36” wide doors

### **10 2123 Cubicle Curtain Track**

---

1. On The Right Track

- Extruded Aluminum, White Baked Enamel.
- Standard Concealed Stainless-Steel hardware.
- MUHC Designers to specify cubicle curtain fabrics.
- “No Substitution” or “Sole Source” request must be submitted by the project team if Cubicle Curtain Track is provided by the project.

### **10 2800 Toilet, Bath and Laundry Accessories**

---

1. CF/CI (Contractor Furnished, Contractor Installed) - The following items are typically by Contractor and must be specified. See Finish Legend in Appendix D for preferred or required manufacturers.

- Partially recessed Automatic Paper Towel Dispensers
- Mirror over sink
- Grab bars
- Personal Shelf
- Toilet paper dispenser
- Sanitary napkin disposal (as requested)
- Towel bars
- Individual robe hooks (as requested)
- Specimen pass thru (as requested)

- Surface mounted towel dispensers. Refer to Appendix D for dispenser type based on type of space.
2. OF/CI (Owner Furnished/Contractor Installed) The following items are typically by Owner but must be accommodated in the design process. See Finish Legend for preferred or required manufacturers.
- Soap dispensers
  - Alcohol dispensers.
  - Sharps boxes
  - Glove dispensers
  - Multi-hook coat hooks – **[Umbra Flip Wall Hook]**
  - **[Glass markerboards]** / signage
  - Pharmaceutical waste containers
3. Grab bars and other accessories exposed to frequent cleaning shall be Powder Coated clear or color to prevent chemical rusting.
4. Public restrooms shall utilize ADA accessible, flip-down grab/support bar on the off-wall side of the toilet.
5. Ensure that all shower seats are rated to accommodate patient weight requirements and that the supports/ blocking behind the wall will support/exceed the rating of the seats.
6. Placement of robe/towel hooks in patient rooms should be without sharp edges and placed high enough to prevent patient safety hazard (i.e. catching shoulder or IV tubing on hook). Standard is the **[Umbra Flip Wall Hook]**. Ensure hooks meet ADA requirements.

END OF SECTION